


| SCHEDULE OF ITEMS | |
|-------------------|---|
| ITEM NO. | DESCRIPTION |
| 1 | ISOLATING VALVE. IF BUTTERFLY VALVE TO BE GEAR SHUT TYPE (RESILIENT SEATED) |
| 2 | SINGLE CHECK DETECTOR ASSEMBLY TESTABLE. VALVE TO CONFORM TO AS/NZS2845 |
| 3 | 25mm BYPASS METER SUPPLIED BY WATER CORPORATION. |
| 4 | 25mm DUAL SPRING LOADED CHECK VALVE |
| 5 | LOCKABLE BALL VALVES WITH A003 KEYED LOCKS |
| 6 | TEST PORT |
| 7 | WATER METER FOR GENERAL SERVICE |
| 8 | APPROPRIATE BFD |
| 9 | RIGHT ANGLE STOP TAP |

| STANDARD LEGEND | | |
|-----------------|------------|---|
| × | V | Valve |
| ○ | M | Meter |
| □ | D.B. | Dirt Box |
| — | S.P. | Straight Piece |
| ┆ | T.F. | Testing Ferrule |
| ▭ | L.S. | Line Strainer |
| ⌌ | B.P.D. | Backflow Prevention Device (Testable or Non-Testable) |
| ⌌ | S.C.V.T. | Single Check Valve Testable |
| ⌌ | S.C.D.A.T. | Single Check Detector Assembly Testable |

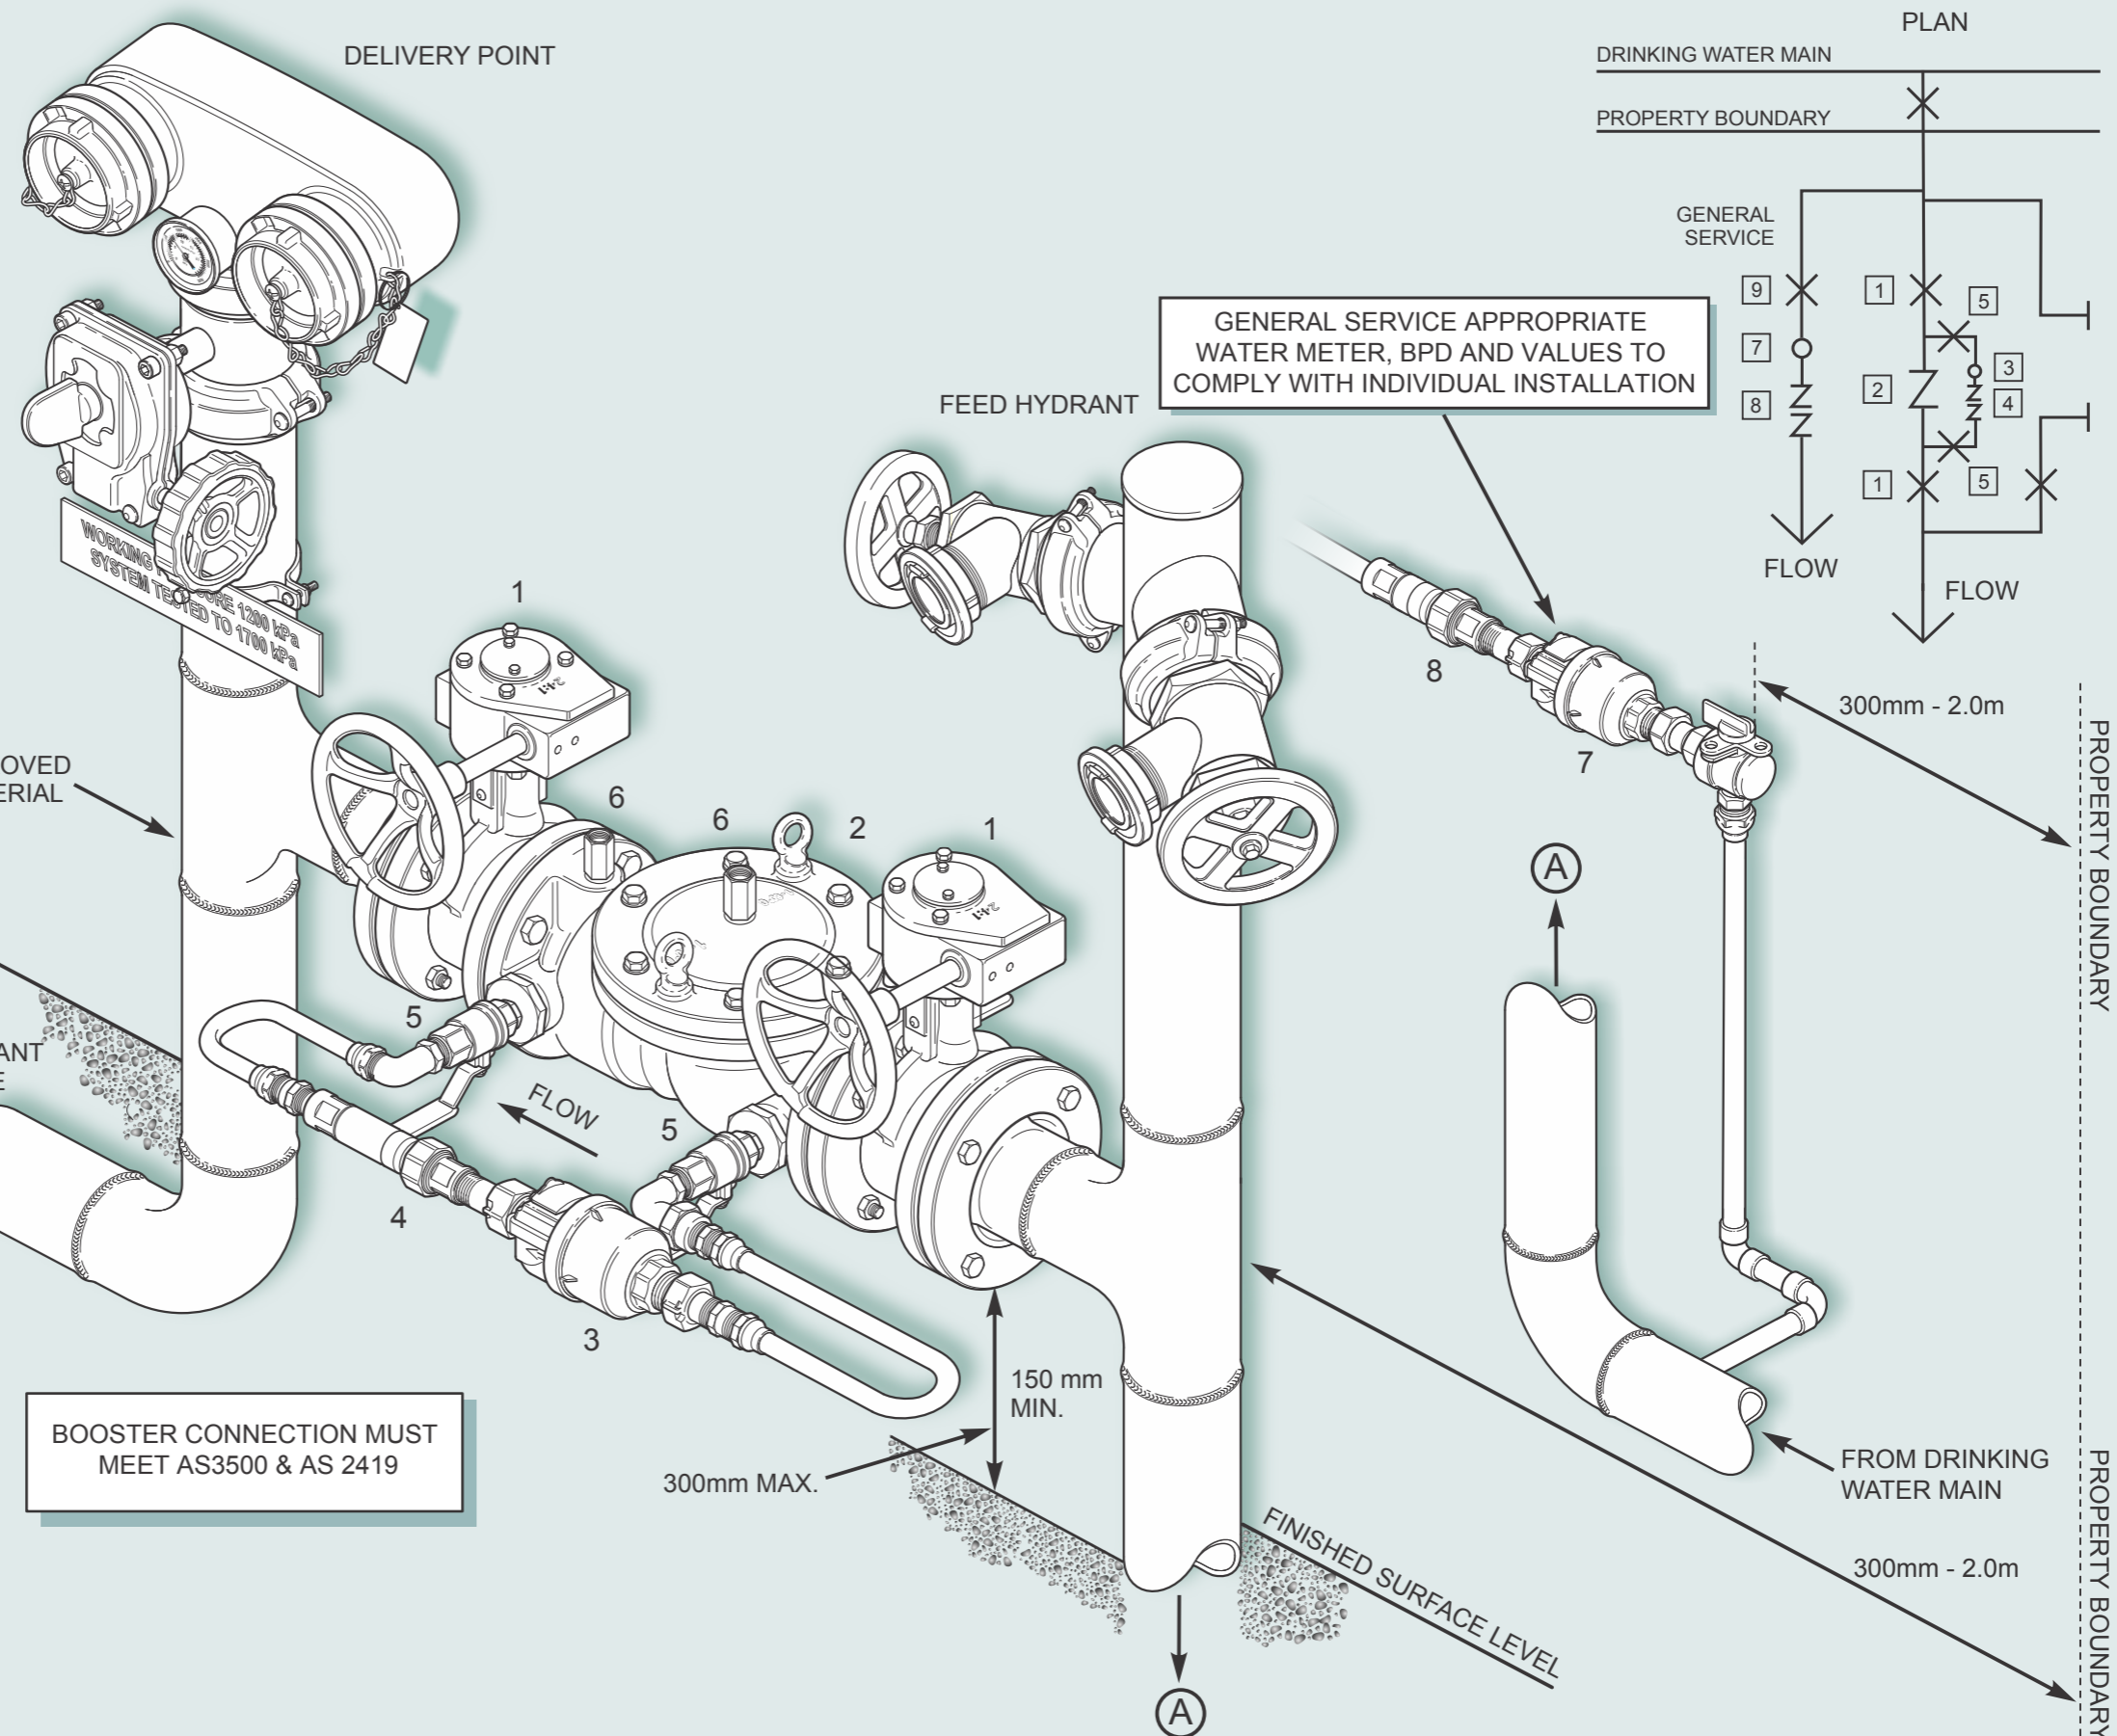

GWMWATER MAINTAINS 25MM BYPASS METER ONLY ON PRIVATE FIRE SERVICE

BOOSTER CONNECTION MUST MEET AS3500 & AS 2419

DRAWING NUMBER:
14

SCALE:
NOT TO SCALE

DATE:
MARCH 2022

BOOSTER CONNECTION AROUND METERED PRIVATE FIRE SERVICE – LOW HAZARD

