



ON FIRE SERVICES, ANY USE OF NON-METALLIC PIPE ABOVE GROUND IS RESTRICTED TO UPSTREAM OF THE LAST UPTURNED BEND ON THE RISER TO THE ASSEMBLY.  
**NOTE: USE OF GALVANISED WROUGHT IRON PIPE (GWIP) IS PROHIBITED IN ANY PART OF THE INSTALLATION UPSTREAM OF THE ASSEMBLY.**

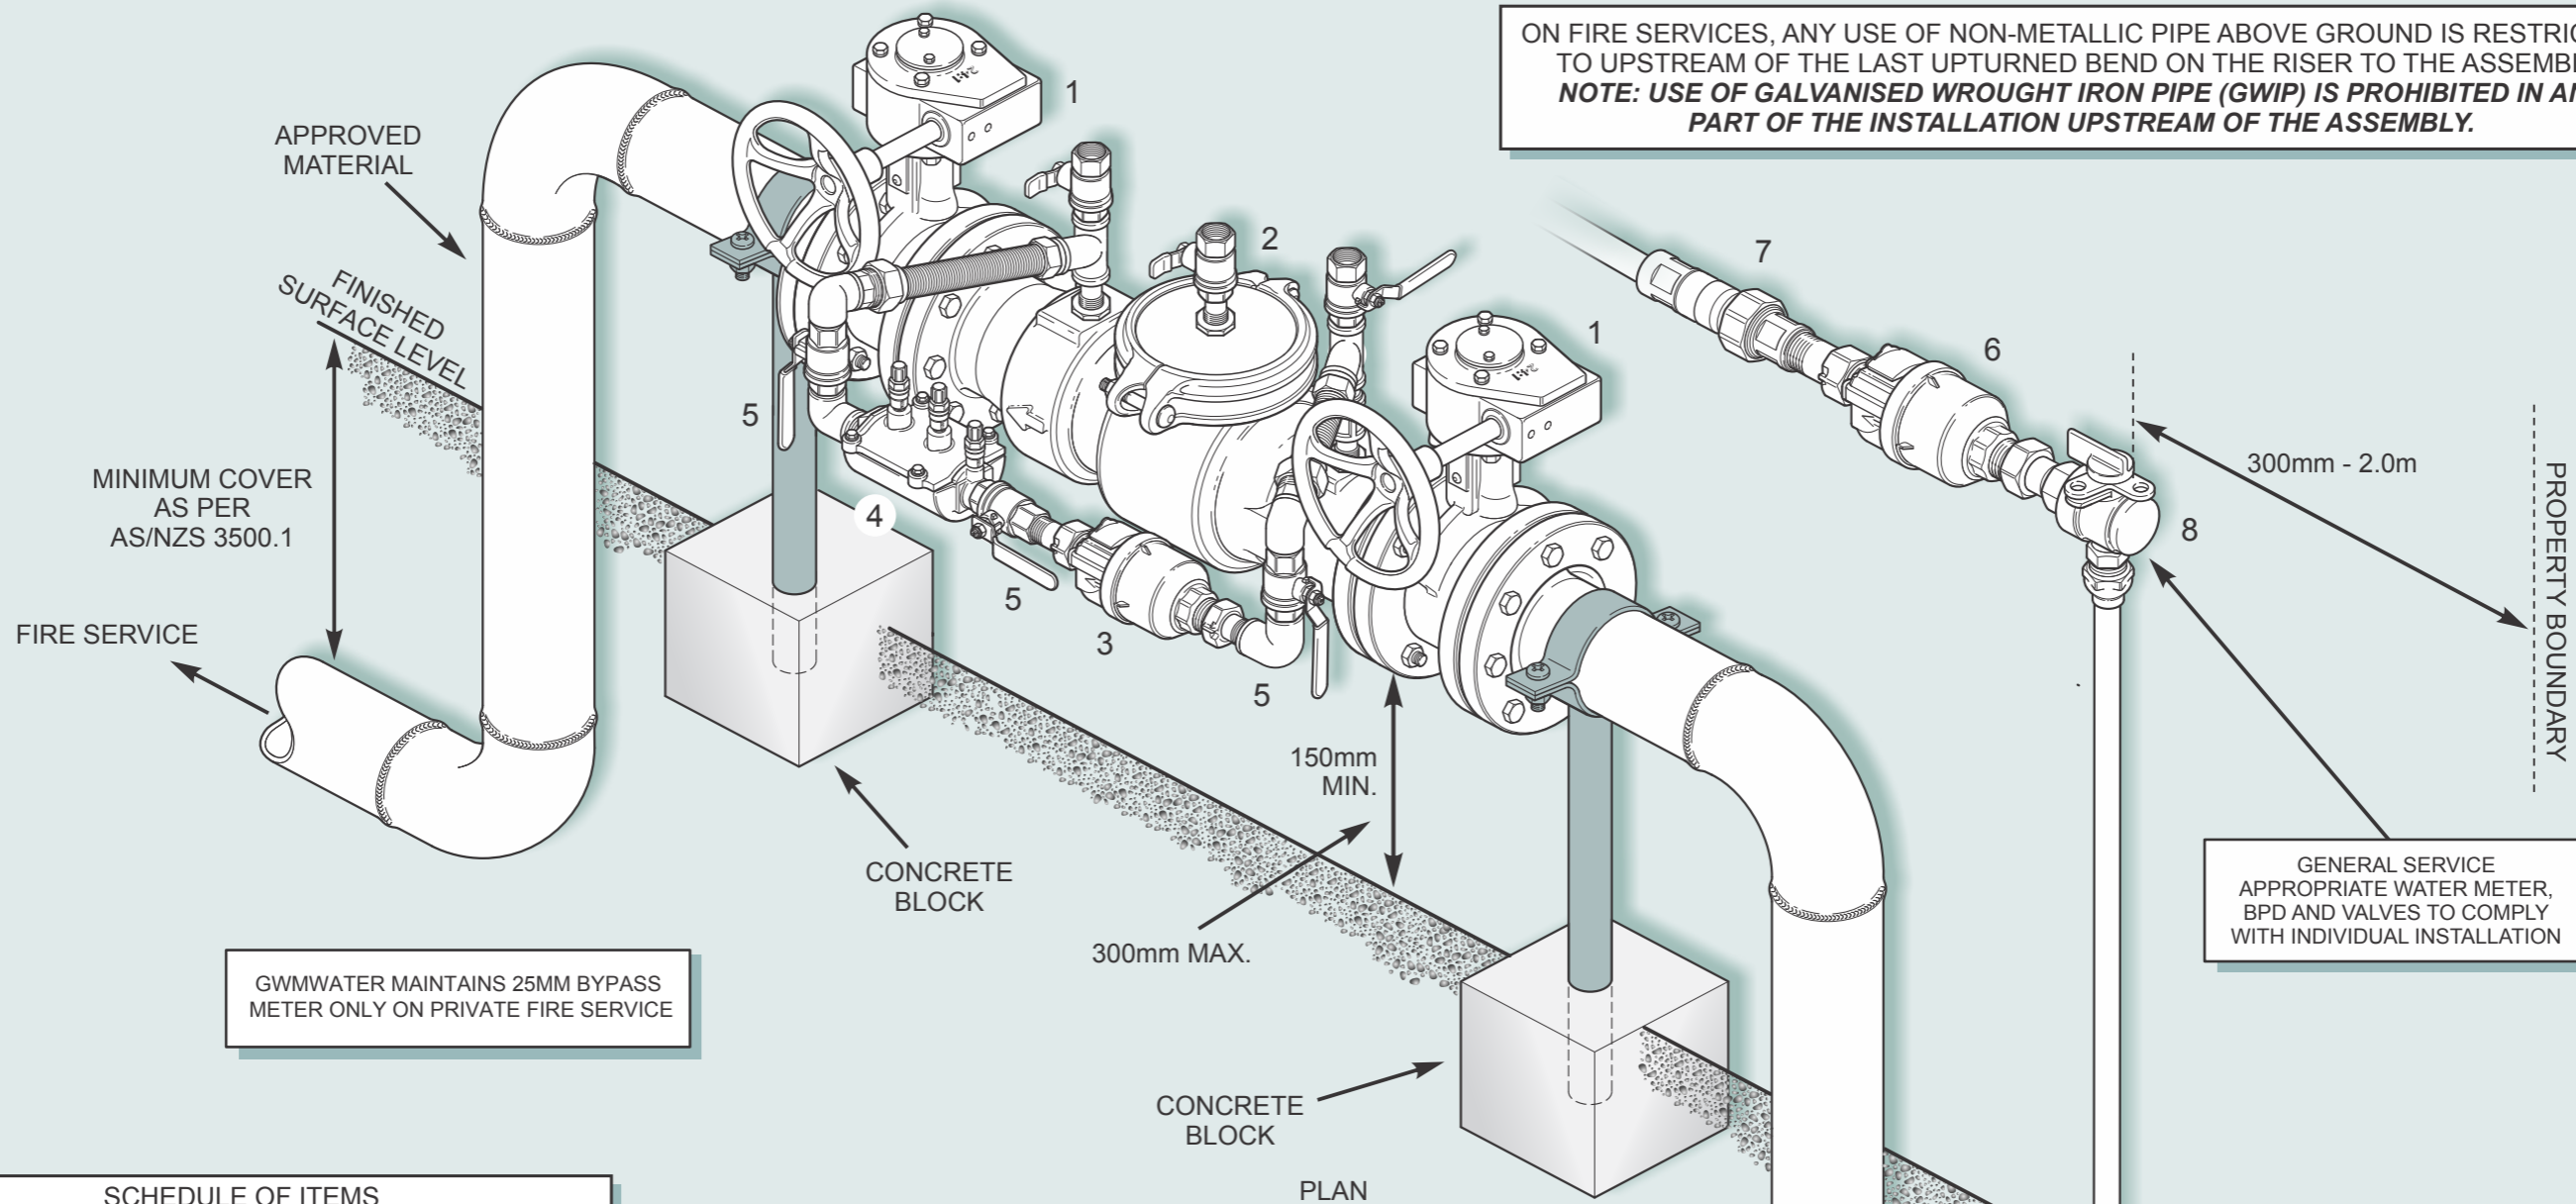

SCHEDULE OF ITEMS	
ITEM NO.	DESCRIPTION
1	ISOLATING VALVE. IF BUTTERFLY VALVE TO BE GEAR SHUT TYPE (RESILIENT SEATED)
2	DOUBLE CHECK DETECTOR ASSEMBLY TESTABLE. VALVE TO CONFORM TO AS/NZS2845
3	25mm BYPASS METER SUPPLIED BY WATER CORPORATION
4	DOUBLE CHECK VALVE TESTABLE
5	LOCKABLE BALL VALVES WITH A003 KEYED LOCKS
6	WATER METER FOR GENERAL SERVICE
7	APPROPRIATE BDFD
8	RIGHT ANGLE STOP TAP

STANDARD LEGEND		
⊗	V	Valve
○	M	Meter
□	D.B.	Dirt Box
—	S.P.	Straight Piece
⊥	T.F.	Testing Ferrule
▭	L.S.	Line Strainer
∩	B.P.D.	Backflow Prevention Device (Testable or Non-Testable)
Z	S.C.V.T	Single Check Valve Testable
⊥	S.C.D.A.T.	Single Check Detector Assembly Testable

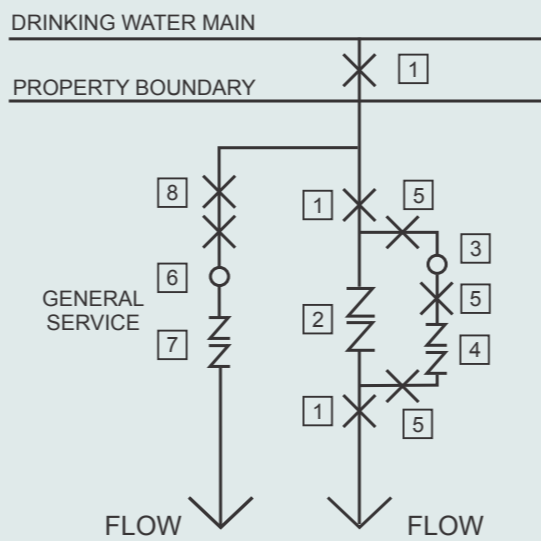

DRAWING NUMBER:  
**10**

SCALE:  
NOT TO SCALE

DATE:  
MARCH 2022

80mm+ PRIVATE FIRE SERVICE – MEDIUM HAZARD  
TYPICAL ARRANGEMENT

